

## FOUNDATION AND GROUND FLOOR PLAN T.O. SLAB = +0'-0" T.O. FOUNDATION = AS NOTED

## PLAN NOTES:

- 1. TOP OF GRADE BEAM SHALL NOT DEVIATE BY MORE THAN 1/8".
- GB-1 DENOTES A 14"x18" DEEP GRADE BEAM WITH 3 #7 TOP AND BOTTOM AND #3 STIRRUPS @6" O.C.
- 3. DOORS AND WINDOWS SHALL BE RATED FOR A +-41PSF SERVICE WIND PRESSURE
- 4. ROOFING SHALL BE RATED FOR A -96PSF SERVICE UPLIFT WIND PRESSURE

PLAN KEYNOTES: 1 8" SLAB ON GRADE WITH #4 @12" O.C. EACH WAY MID. 2 6" SLAB ON GRADE WITH 6x6 - W2.9xW2.9 W.W.R. SEE STRUCTURAL NOTES 3 4" SLAB ON GRADE WITH 6x6 - W2.9xW2.9 W.W.R. SEE STRUCTURAL NOTES 4 ROOFING (SEE ARCHITECTURALS) ON 2" NORMAL

WEIGHT CONCRETE REINFORCED WITH 6x6-W2.9xW2.9 WWR ON 3"-18GAGE, TYPE 'VL' GALVANIZED METAL DECK (5" TOTAL THICKNESS)

5 12" SLAB ON GRADE WITH #4 @12"O.C EACH WAY TOP AND BOTTOM

1/4" = 1'-0"

## PLAN LEGEND:


DENOTES EXISTING TILT WALL DENOTES LOAD BEARING MASONRY MASONRY REINFORCING NOTATION

#5 VERTICAL \_\_\_\_\_\_ @24" O.C. REINFORCING

M8-524

8" MASONRY \_\_\_\_\_ DENOTES LOAD BEARING MASONRY DENOTES EXISTING TILT WALL

		FC	OTING S	SCHEDUL	E	
	SIZE WxLxD	REINFORCING				
TYPE		BOTTOM		TOP		REMARKS
		L.W.	S.W.	L.W.	S.W.	
F-3.0	3' - 0"x3' - 0"x12"	4 #5	5 #5	-	-	
F-4.0	4' - 0"x4' - 0"x12"	5 #5	5 #5	-	-	

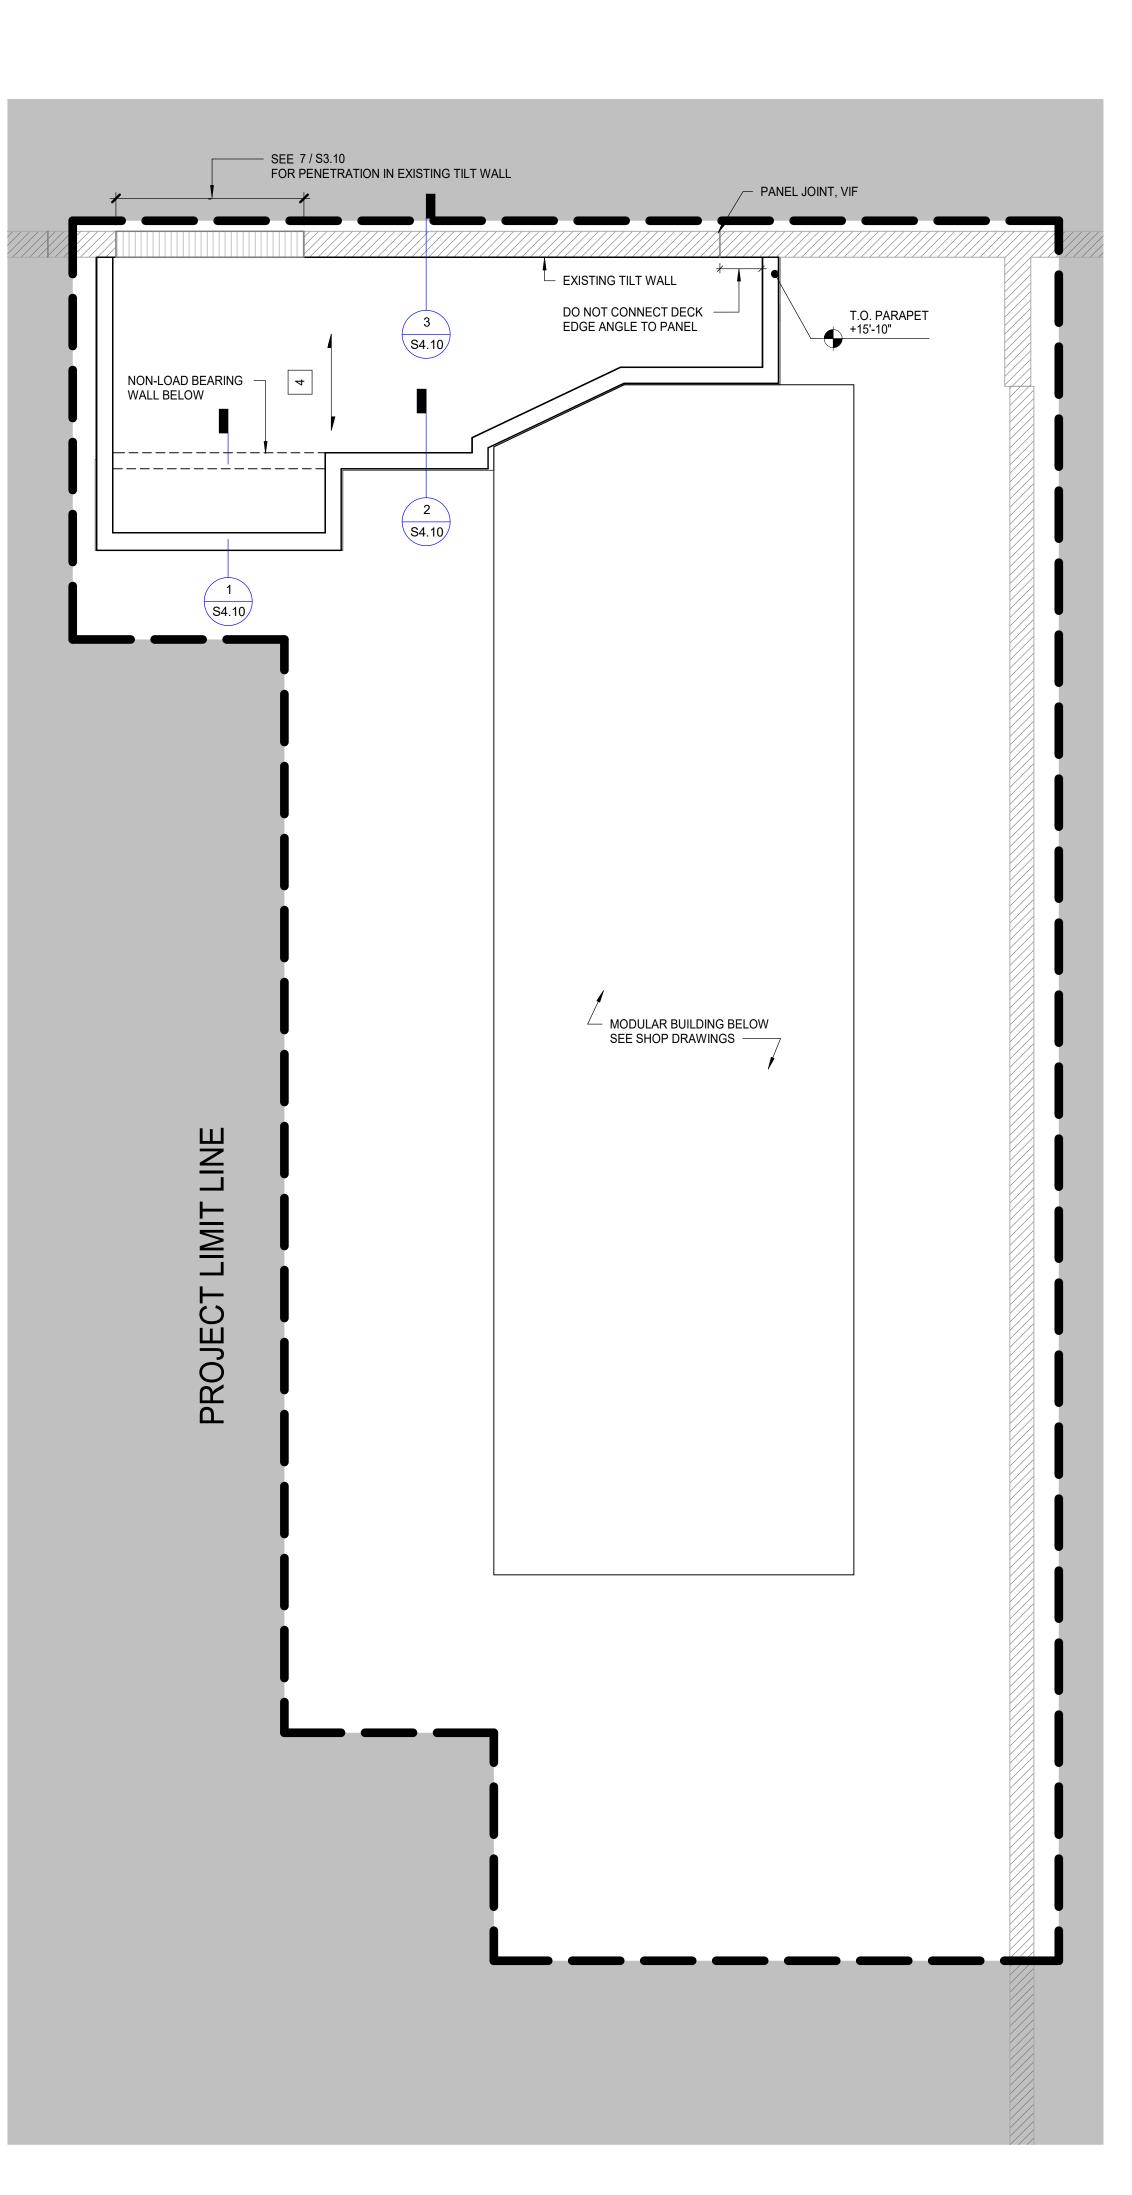

## ROOF FRAMING PLAN

1/4" = 1'-0"

